

International Patent Public No.:

WO 2006/007772

US Patent No.: 7549446 India Patent No.: 232582 Russia Patent No.: 2349819

South Korea Patent No.: 10-0914137

Mexico Patent No.: 268581

Australia Patent No.: 2005263257 Philippine Patent No.: 1-2006-502553

Taiwan Patent No.: M287896

Multi-functional Flow Control Valve for Water Treatment Systems

63502, 63502B (Old Model No.: F65B1, F65G1)

63602, 63602B (Old Model No.: F65B3, F65G3)

73502, 73502B (Old Model No.: F69A1, F69G1)

73602, 73602B (Old Model No.: F69A3, F69G3)

User Manual





Please read this manual in details before using this valve and keep it properly in order to consult in the future 0WRX.466.507

Before the valve put into use, please fill in the below content so as to help us to refer in the future.

The Program Type Setting (Operation by professional)

When all symbols light on, press and hold and buttons for 5 seconds to enter the menu of valve model selection. Please set the program type in accordance with the product type. (Time clock type by days or hours, or meter type. For example, F65B1 or F65G1 should be set to F65B1; F65B3 or F65G3 should be set to F65B3. You couldn't set to other type.)

Softener System Configuration

Tank Size: Dia.	mm;	Height	mm;
Resin Volume	L; B	rine Tank Capacity	L;
Hardness of Raw Water	_mmol/L;	Pressure of Inlet Water	MPa;
Control Valve Model		; Number	;
The Specification of Drain Line Flow	v Control	; Injector No	F
Water Source: Ground-water □:	Filtered G	round-water :	
Tap Water □;	Other	→ *()	

Parameter Set

Parameter	Unit	Factory Default	Actual Value
Time of Day	H:m	Random	
Control Mode A-01 (02, 03, 04)	1	A-01	
Unit Mode HU-01 (02, 03)	1	HU-01]-
Water Treatment Capacity (Meter type)	m³	10.00	
Service Days (Time clock type, by days)	D.	03	15
Service Hours (Time clock type, by hours)	H.	20	
Regeneration Time	1	02:00	
Backwash Time	Min.sec	10:00	
Brine & Slow Rinse Time	Min.sec	60:00	
Brine Refill Time	Min.sec	05:00	
Fast Rinse Time	Min.sec	10:00	
Maximum Interval Regeneration Days	D.	30	
Output Mode b-01 (02)	1	b-01	

• If there is no special requirement when product purchase, we choose 6305 (old) injector and 8468005 (3#) drain line flow control for the standard configuration; if need new injector, we choose 6804 (new) injector and 8468061 drain line flow control for the standard configuration.

Catalogue

Notice	3
1. Product Overview	4
1.1. Main Application & Applicability	4
1.2. Product Characteristics.	4
1.3. Service Condition	7
1.4. Product Structure and Technical Parameters	8
1.5. Installation	9
2. Basic Setting & Usage	12
2.1. The Function of PC Board	12
2.2. Basic Setting & Usage	14
3. Applications	
3.1. Softener Flow Chart	18
3.2. The Function and Connection of PC Board	20
A.Signal Output Connector	21
B.Interlock	24
C.Pressure Relief Output	24
D.Remote Handling Connector	25
E.Interlock System	25
F.Series System	25
3.3. System Configuration and Flow Rate Curve	26
3.4. Parameter Settlement	28
3.5. Parameter Enquiry and Setting	30
3.6. Trial Running.	34
3.7. Trouble-Shooting	36
3.8. Assembly & Parts	39
4 Warranty Card	40

Notice

- To ensure normal operation of the valve, please consult with professional installation or repairing personnel before use it.
- If there are any of pipeline engineering and electric works, there must be finished by professional at the time of installation.
- Do not use the control valve with the water that is unsafe or unknown quality.
- Depending on the changing of working environment and water requirement, each parameter of softener should be adjusted accordingly.
- When the water treatment capacity is too low, please check the resin. If the reason is short of resin, please add; if the resin is turn to reddish brown or broken, please replace.
- Test water periodically to verify that system is performing satisfactorily.
- Sodium used in the water softening process should be considered as part of your overall dietary salt intake. Contact doctor if you are on a low sodium diet.
- Ensure that there is solid salt all the time in the brine tank in the course of using, when this valve is used for softening. The brine tank should be added crystalline coarse salt only, at least 99.5% pure, forbidding use the small salt.
- Do not put the valve near the heat sources or surroundings with high humidity, corrosive, intense magnetic field or intense librations environment. And do not leave it outside.
- Forbidden to carry the injector body. Avoid to use injector body as support to carry the system.
- Forbidden to use the brine tube or other connectors as support to carry the system.
- Please use this product under the water temperature between $5 \sim 50^{\circ}$ C, water pressure $0.15 \sim 0.6$ MPa. Failure to use this product under such conditions voids the warranty.
- If the water pressure exceeds 0.6MPa, a pressure reducing valve must be installed before the water inlet. While, if the water pressure is under 0.15MPa, a booster pump must be installed before the water inlet.
- PPR pipes, corrugated pipes, or UPVC pipes are recommended for pipe installation and aluminum-plastic pipes should be avoided.
- Do not let children touch or play, because careless operations may cause the procedure changed.
- When the attached cables of this product and transformer are damaged, they must be changed to the one that is from our factory.

1. Product Overview

1.1. Main Application & Applicability

Used for softening or demineralization water treatment systems

Be suitable for Residential softening system

Ion exchange equipment

Boiler softening water system

RO pretreatment softening system, etc.

1.2. Product Characteristics

Simple structure and reliable sealing

It adopts hermetic head faces with high degree pottery and corrosion resistance for opening and closing. It combines with Service, Backwash, Brine & Slow Rinse, Brine Refill and Fast Rinse.

- No water pass the valve in regeneration in single tank type
- Manual function

Realize regeneration immediately by pressing "at any time. ..

Long outage indicator

If outage overrides 3 days, the time of day indicator "12:12" will flash to remind people to reset new time of day. The other set parameters do not need resetting. The process will continue to work after power on.

● LED dynamic screen display

The stripe on dynamic screen flash, it indicates the control valve is in service, otherwise, it is in regeneration cycle.

Buttons lock

No operations to buttons on the controller within 1 minute, button lock indicator lights on which represent buttons are locked. Before operation, press and hold the "a" and "a" buttons for 5 seconds to unlock. This function can avoid incorrect operation.

• Interval backwash times (Suitable for F69)

It could set up interval backwash times for F69 up-flow regeneration valve which means several times of services but one time of backwash. The setting of interval backwash time depends on the local water turbidity. (The lower the turbidity is, the longer of the interval backwash times can be set)

● It can choose time clock type or meter type by program selection

When all symbols light on, press and hold and buttons for 5 seconds to enter the menu of valve model selection. Please set the program type in accordance with the product type. (Time clock type by days or hours or meter type) (Note: The meter type product has one flow meter and probe wire, but the time clock type doesn't have).

● Four kinds of meter type can be selected (Suitable for F65B3, F65G3, F69A3, F69G3)

Model	Name	Instruction
A-01	Meter Delayed	It will not regenerate although the available volume of treated water drops to zero (0). Regeneration will start until at the regeneration time.
A-02	Meter Immediate	Regenerate immediately when the available volume of treated water drops to zero (0).
A-03	Intelligent Meter Delayed	Meter Delayed Regeneration type, by setting resin volume, feed water hardness, regeneration factor, the controller will calculate the system capacity.
A-04	Intelligent Meter Immediate	Meter Immediately Regeneration Type, by setting resin volume, feed water hardness, regeneration factor, the controller will calculate the system capacity.

There are two kinds of regeneration mode for time clock type

When the program is set to time clock type by days (Such as F65B1, F69A1, etc.), it can be changed to be by hours by dialing the red switch on main control board to "1" (Refer to the figure in P21). Pointing to "ON" means the time clock type service by days. (Note: After dialing the switch, please restart the power)


● Interlock function

It has a function of interlock to realize only one valve in regeneration but the other valves are in service while several valves parallel in system. In multi-steps treatment systems such as RO pre-treatment, when several valves are in series, there is only one valve in regeneration or washing, to ensure pass water all the times while different valves in regeneration or washing.(Application refers to Figure 3-9)

Signal output

There is a signal output connector on main control board. It is for controlling external wiring (Refer to Figure 3-1 to Figure 3-8).

There are two kinds of output modes. b-01 Mode: Turn on start of regeneration and shut off at the end of regeneration; b-02 Mode: Signal available only intervals of regeneration cycles and in service.

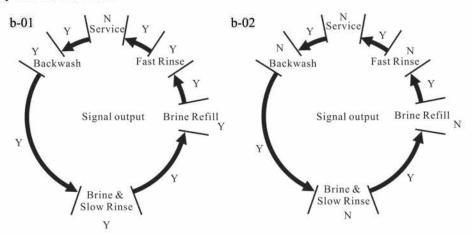

Remote handling input

This connector can receive external signal, used together with PLC, and computer etc. to control the valve. (Application refers to Figure 3-11)

Pressure relief output

The valve will cut off feeding water to drain line when it switches in regeneration cycles (Same as signal output b-02). Thus in some water treatment system, e.g. Deep Well, one booster pump was installed on the inlet to increase the system water feeding pressure, this cut-off will cause pressure on inlet rising too fast to damage the valve. Pressure Relief Output can be used to avoid this problem. (Application refers to Figure 3-10)

Maximum interval regeneration days

Under the situation of service reaching the setting days and the volume not yet, it could enter into regeneration process forcibly when current time is the same as regeneration time.

All parameters can be modified

According to the water quality and usage, the parameters in the process can be adjusted.

1.3. Service Condition

Runxin Valve should be used under the below conditions:


	Items	Requirement			
Working	Water pressure	0.15MPa ~ 0.6MPa			
conditions	Water temperature	5°C ~ 50°C			
W-1d-	Environment temperature	5℃ ~50℃			
Working environment	Relative humidity	≤95% (25°C)			
	Electrical facility	AC100 ~ 240V/50 ~ 60Hz			
	Water turbidity	Down-flow regeneration < 5FTU; Up-flow regeneration < 2FTU			
Inlet water	Water hardness	First Grade Na ⁺ <6.5mmol/L; Second Grade Na ⁺ <10mmol/L			
quality	Free chlorine	< 0.1mg/L			
	Iron ²⁺	< 0.3mg/L			
	CODMn	<2mg/L (O ₂)			

In the above table, First Grade Na⁺ represents First Grade Na⁺ Exchanger. Second Grade Na⁺ represents Second Grade Na⁺ Exchanger.

- When the water turbidity exceeds the conditions, a filter should be installed on the inlet of control valve.
- When the water hardness exceeds the conditions, the outlet water hardness will hardly reach the requirement of boiler feed water (0.03 mmol/L) . It is suggested to adopt second grade softener.

1.4. Product Structure and Technical Parameters

Product dimension (The appearance is just for reference. It is subjected to the real

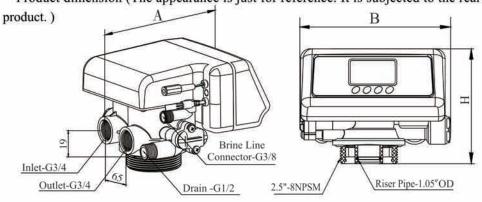

Model	Model A(mm) max		H(mm) max	Flow Rate m³/h @0.3MPa	Regeneration Mode	
F65B3/F65B1	187.3	187.8	142.8	2.0	Down-flow	
F69A3/F69A1	196.4	187.8	152.8	2.0	Up-flow	
F65G3/F65G1	179.8	207.8	167.8	2.0	Down-flow	
F69G3/F69G1	179.8	207.8	167.8	2.0	Up-flow	

Note:

1. OD-Outer Diameter, 1.05OD=26.7mm

2. Transformer Output: DC12V/1.5A

1.5. Installation

A. Installation notice

Before installation, read all those instructions completely. Then obtain all materials and tools needed for installation.

The installation of product, pipes and circuits should be accomplished by professional to ensure the product can operate normally.

Perform installation according to the relevant pipeline regulations and the specifications of Water Inlet, Water Outlet, Drain Outlet, Brine Line Connector.

B. Device location

- 1) The filter or softener should be located close to drain.
- ②Ensure the unit is installed in enough space for operating and maintenance.
- (3)Brine tank needs to be close to softener.
- The unit should be kept away the heater, and not be exposed outdoor. Sunshine or rain will cause the system damage.
- ⑤ Avoid installing the system in circumstance of acid/alkaline, magnetic or strong vibration, because above factors will cause the system disorder.
- ⑥Do not install the filter or softener, drain pipeline or overflow pipe in circumstance where temperature may drop below 5°C, or above 50°C.
- Tinstall the system in the place where with the minimum loss in case of water leakage.

C. Pipeline installation

1 Install control valve

- a. As the Figure 1-1 shows, select the riser pipe with 26.7mm OD, glue the riser pipe to the bottom strainer and put it into the mineral tank, cut off the exceeding pipe out of tank top opening and make external rounding.
- b. Fill the mineral to the tank, and the height is accordance with the design code.
- c. Install the top strainer to the valve.
- d. Through the top strainer, insert the riser pipe into control valve and screw tight control valve.




Figure 1-1

Note:

- The length of riser pipe should be neither 2mm higher nor 5mm lower than tank top opening, and its top end should be rounded to avoid damaging of O-ring inside the valve.
- Avoid filling floccules substance together with resin to the resin tank.
- Avoid O-ring inside control valve falling out while rotating it on the tank.

2 Install animated connector

As Figure 1-2 shows, put the sealing ring into nut of animated connector, and screw in water inlet.

3 Install flow meter

As Figure 1-2 shows, put the sealing ring into nut of flow meter, screw in water outlet; insert the probe wire into flow meter.

4 Pipeline connection

- a. As Figure 1-3 shows, install a pressure gauge in water inlet.
- b. Install valve A, valve B, valve C and valve D in the inlet, outlet and middle of the pipeline. The valve D is sampling valve. (Or adopt F70B bypass valve).
- c. Install a check valve in water outlet.
- d. Inlet pipeline should be in parallel with outlet pipeline. Support inlet and outlet pipeline with fixed holder.



Figure 1-2




Figure 1-3

Note:

- If the water outlet or water tank is installed higher than control valve or parallel interlock system with multi-outlets, a liquid level controller must be installed in brine tank or a check valve must be installed in the outlet. Or else, the water in water outlet or water tank will flow backwards into brine tank when backwash.
- If making a soldered copper installation, do all sweat soldering before connecting pipes to the valve. Torch heat will damage plastic parts.
- When turning threaded pipe fitting onto plastic fitting, do not use excessive force to make threads misaligned or broken valve.
- If the valve belongs to time clock type, there are no step ② and ③.

5 Install drain pipeline

- a. As the Figure 1-4 shows, slide the drain hose connector into drain outlet.
- b. Insert drain line flow control into drain outlet
- c. Screw drain hose connector into drain outlet, and lock it.
- d. Locate the drain hose well as the Figure 1-4 shows.

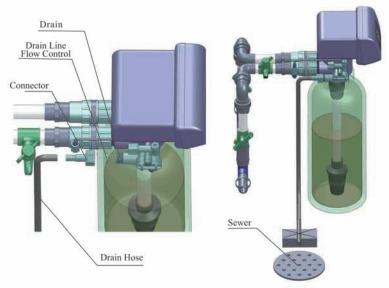


Figure 1-4

Note:

- Control valve should be higher than drain outlet, and be better not far from the drain hose.
- Be sure not connect drain with sewer directly, and leave a certain space between them, avoid wastewater being absorbing to the water treatment equipment, such as showed in the Figure 1-4.

6 Connect brine tube

- a. As Figure 1-5 shows, slide 3/8" brine tube hose connector over end of brine tube.
- b. Insert tube bushing into the end of brine tube.
- c. Insert the red brine line flow control into valve brine line connector (Note: cone side of control should face into valve)
- d. Tighten nut onto brine line connector.
- e. Connect the other end of brine tube with the brine tank. (The liquid level controller and air-blocker should be installed in the brine tank.)

Note:


The brine tube and drain pipeline should not be bended or plugged.



Figure 1-5

2. Basic Setting & Usage

2.1. The Function of PC Board

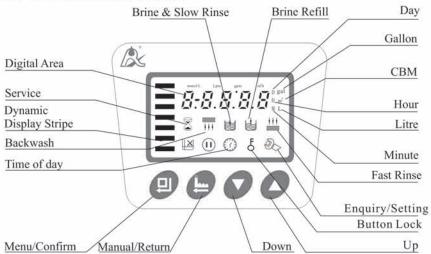

- A. "(?)" Time of day indicator • "" Lights on, display the time of day. • "12:12" flashes, remind you to reset the time of day if electrical service interrupted 3 days more (If electrical service interrupted within 3 days, it doesn't need to reset the time.) B. & Button lock indicator • E Lights on, indicate the buttons are locked. At this moment, press any single button will not work (No operation in one minute, & will light on and lock the buttons.) • Solution: Press and hold both and for 5 seconds until the \(\frac{\xi}{2} \) lights off. C. Program mode indicator • & Lights on, enter program display mode. Use or to view all values. • A Flashes and enter program set mode. Press or to adjust values. D. Menu/Confirm button • In menu mode, press and lights on, then enter program display mode to view all values. • In program display mode, press , or flashes, enter program set mode, press or to adjust values. • Press @ after all program are set, and then the voice "Di" means all setting are successful and return program display mode. E. Manual/Return button • Press 😑 in any status, it can proceed to next step. (Example: After unlock the buttons, press in service status, it will start regeneration cycles instantly if the outlet water is unqualified; Press p while it is in backwash status, it will end backwash and go to brine
- &slow rinse at once.)

 Press in program display mode, and it will return in service. Press in program set mode, and it will return program display mode.
- Press while adjusting the value, then it will return program display mode directly without saving value.

F.Up and Down

- In program display mode, press or to view all values.
- In program set mode, press or to adjust values.
- Press and hold both 🔼 and 🕡 for 5 seconds to unlock the buttons.

2.2. Basic Setting & Usage

A. Parameter specification

Function	Indicator	Factory Default	Parameter Set Range	Instruction
Time of Day	"②"	Random	00: 00 ~ 23:59	Set the time of day when use, ": " flashes
			A-01	Meter Delayed: Regenerate will not start although the available volume of treated water drops to zero (0). Regeneration will start until at the regeneration time.
			A-02	Meter Immediate: Regenerate immediately when the available volume of treated water drops to zero (0).
Control Mode	A-01	A-01	A-03	Intelligent Meter Delayed: By setting resin volume, feed water hardness, regeneration factor, the controller will calculate the system capacity. Regeneration mode same as A-01.
			A-04	Intelligent Meter Immediate: By setting resin volume, feed water hardness, regeneration factor, the controller will calculate the system capacity. Regeneration mode same as A-02.
Unit Mode	HU-01	HU-01	01, 02, 03	01-m³; 02-gal; 03-L
Service Days	2	1-03D	0∼99Days	Only for Time Clock Type, regeneration by days
Service Hours	2	1-20H	0∼99 Hours	Only for Time Clock Type, regeneration by hours
Regeneration Time	02:00	02:00	00: 00 ~ 23:59	Regeneration time; ": " lights on
Interval Backwash Times	F-00	00	0 ~ 20	Interval backwash times. For example, F-01:indicate service 2 times, backwash 1 time
Resin Volume	50L	50L	5 ~ 500L	Resin volume in resin tank (L)

Feed Water Hardness	Yd1.2	1.2	0.1 ~ 9.9	Feed water hardness (mmol/L)
Exchange Factor	AL.65	0.65	0.30 ~ 0.99	Relate to the raw water hardness. When hardness is higher, the factor is smaller.
Water Treatment Capacity	2	10m³	$0 \sim 99.99 \text{m}^3$	Water treatment capacity in one circle (m³)
Backwash Time	111	10min.	0 ~ 99:59	Backwash time(Minute)
Brine & Slow Rinse Time		60min.	0~99:59	Brine &Slow rinse time(Minute)
Brine Refill Time		5min.	0~99:59	Brine refill time(Minute)
Fast Rinse Time	111	10min.	0~99:59	Fast rinse time(Minute)
Maximum Interval Regeneration Days	H-30	30	0 ~ 40	Regenerate at the regeneration time even though the available volume of treated water does not drop to zero (0).
Output Control Mode	b-01	01	01 or 02	b-01: Signal turn on when start of regeneration and shut off at the end of regeneration. (Connection refers to the Figures on P6) b-02: Signal available only in intervals of each status. (Connection refers to the Figures on P6)

B. Process Display

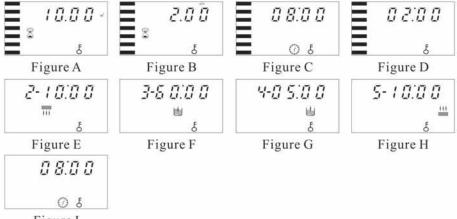


Figure I

Illustration:

- In Service status, the figure shows A/B/C/D; In Backwash status, it shows figure E/I; In Brine& Slow Rinse status, it shows F/I; In Brine Refill status, it shows figure G/I; In Fast Rinse status, it shows figure H/I. In each status, every figure shows 15 seconds.
- ◆ Above displays are taking the meter type for example. For the time clock type, it shows the rest days or hours, such as 1-03D or 1-10H.
- The display screen will only show "-00-" when the electrical motor is running.
- The time of day figure "⑦" flashes continuously, such as "12:12" flashes, indicates long outage of power. It reminds to reset the time of day.
- The display will show the error code, such as "-E1-" when the system is in error.
- Working process: Service→Backwash→Brine & Slow Rinse→Brine Refill→Fast Rinse
 →Service.

C. Usage

After being accomplished installation, parameter setting and trial running by professional, the valve could be put into use. In order to ensure the quality of outlet water can reach the requirement, the user should complete the below works:

- ① Ensure that there is solid salt all the time in the brine tank in the course of using when this valve is used for softening. The brine tank should be added crystalline coarse salt only, at least 99.5% pure, forbidding use the small salt and iodized salt.
- ② Test the hardness of outlet water and raw water at regular time. When the outlet water hardness is unqualified, please press the ⑤ and the valve will temporarily regenerate again(It will not affect the original set operation cycle)
- ③When the feed water hardness change a lot, you can adjust the water treatment capacity as follow:

Press and hold both and for 5 seconds to unlock the buttons. Press , and the lights on, then press , the digital area shows the control mode. If it shows A-01 or A-02, press three times, and the digital area will show the given water treatment capacity (If the control mode shows A-03 or A-04, then press four times, the digital area will show the feed water hardness); Press again, and digital flash. Press or continuously, adjust the capacity value (or water hardness). Press and hear a sound "Di", then finish the adjustment. Press exit and turn back the service status.


For the estimation of water treatment capacity, you can refer to the professional application specification. When selecting A-03 or A-04 intelligent control mode, the controller will automatically calculate the water treatment capacity by setting feed water hardness, resin volume, and regeneration factor.


④ For A-01 or A-03 control mode (Delayed regeneration type), please pay attention to whether the time is current or not. If the time is not right, you can adjust it as below: After unlocking the buttons, press ② , the ② and "②" light on. Then press ② , the ② and hour value flash. Press ② or ② continuously, adjust the hour value; Press ② again, ② and minute value flash. Press ② or ② continuously, adjust the minute value; Press ② and hear a sound "Di" , then finish the adjustment. Press ⑤ exit and turn back the service status.

The regeneration parameters have been set when control valve left factory. Generally, it does not need to reset. If you want to enquiry and adjust the setting, you can refer to the professional application specifications.

3. Applications


3.1. Softener Flow Chart

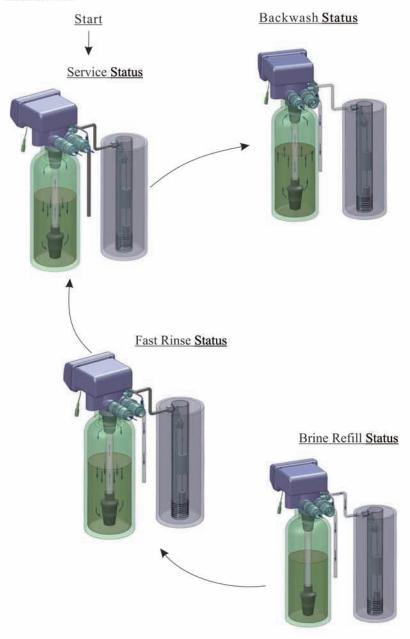

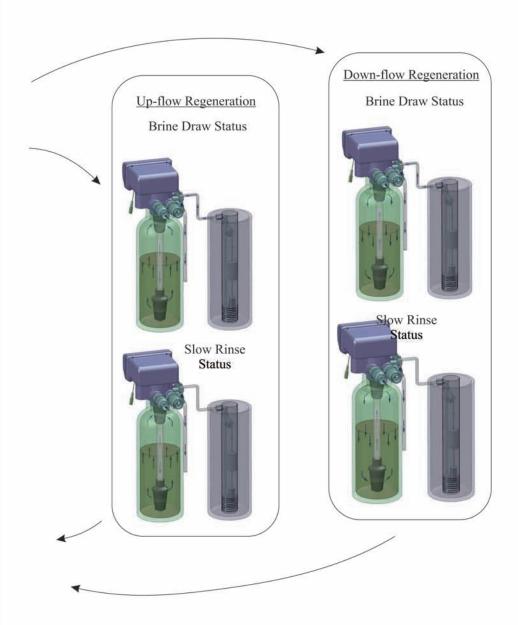

3.2. The Function and Connection of PC Board

Open the front cover of control valve, you will see the main control board and connectors as below:

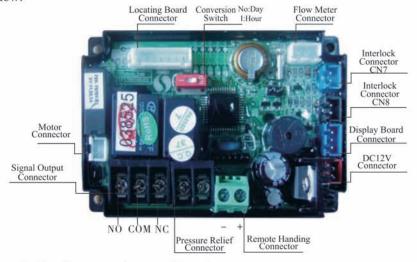

The main functions on main control board:

Function	Application	Explanation
Signal output connector b-01	Outlet solenoid valve	Used in strict requirements regarding no hard water flowing from outlet or control the liquid level in water tank.
	Inlet pump	Increase pressure for regeneration or washing. Use the liquid level controller to control inlet pump to ensure there is water in tank.
Signal output connector b-02	Inlet solenoid valve or inlet pump	When inlet pressure is high, it needs to close water inlet to protect motor when valve is rotating.
Pressure relief connector	Control the inlet bypass to release pressure	Used for pump water supply. When valve is rotating, pressure relief connector opened to prevent pressure increasing rapidly.
Interlock	To ensure only one control valve regeneration or washing in system.	Use in RO Pre-treatment, water supply together but regeneration in turn. Second grade ion exchange equipment, etc.
Remote handling connector	Receipt signal to make the control valve rotate to next status.	It is used for on-line inspection system, connected with PC to realize automatically or remote controlling valve.

A. Signal Output Connector

- 1) Control Outlet Solenoid Valve (Set b-01)
- (1) Solenoid Valve on Outlet Controls the Water Level in Brine Tank

Instruction: If system requires no hard water to flowing from outlet in regeneration cycle (Mainly for no hard water flow out when valve is switching or valve in backwash or brine drawing status), a solenoid valve could be installed on outlet, the wiring refers to Figure 3-1.

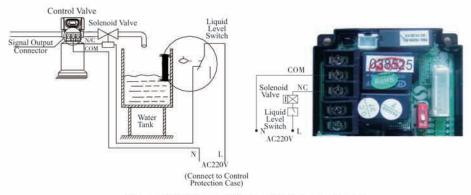


Figure 3-1 Wiring of Solenoid Valve on Outlet

Function:

When valve is in service status, if soft water tank is short of water, solenoid valve will open to supply soft water, but if water tank has enough water, solenoid valve will close, so no soft water will be supplied into soft water tank.

When the valve is in backwash or other regeneration status, there is no signal output. So, solenoid valve will close, and no raw water flows into soft water tank.

②Control Inlet Solenoid Valve (Set b-02)

Instruction: When inlet pressure exceeds 0.6MPa, install a solenoid valve on inlet. Control mode is b-02. Pressure is relieved when valve switching, the wiring refers to Figure 3-2. As Figure 3-3 shows, it also can use the pressure relief connector to work.




Figure 3-2 Wiring of Solenoid Valve on Inlet

Figure 3-3 Wiring of Pressure Relief port

Function:

When inlet pressure is high, install a solenoid valve on inlet to ensure valve switching properly. When the valve is exactly in the status of Service, Backwash, Brine& Slow Rinse, Brine Refill and Fast Rinse, solenoid valve is open. When valve is switching, solenoid valve is closed, no water flows into valve to ensure valve switching properly. It could prevent the problem of mixing water and water hammer.

Use interlock cable to realize valves in parallel and series in same system which is suited for RO pretreatment system or second grade Na⁺ system. The Wiring refers to Figure 3-4:

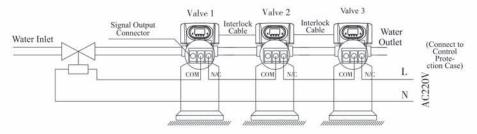


Figure 3-4 Wiring of Solenoid Valve in Inlet

2)Liquid Level Controller Controls Inlet Pump (Two-phase motor) (Set b-01)

Instruction: For the system using well or middle-tank supplying water, switch of liquid level controller and valve together control pump opening or closing. The wiring refers to Figure 3-5:

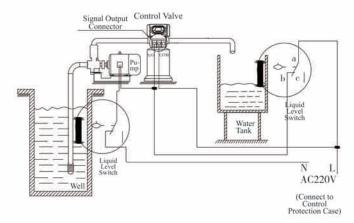


Figure 3-5 Wiring of Liquid Level Controller Controls Inlet Pump

Function:

When valve is in service status, if water tank is short of water, pump starts working; if not, the switch of liquid level controller is closed, so pump doesn't work.

When valve is in backwash or other regeneration status, no matter what is water condition in water tank, open the pump to make sure there is water on inlet. As there is no water flows out of outlet in regeneration cycle, it ensures no water fill into brine tank. A liquid level controller at the top opening of well or in middle water tank in RO system can protect pump from working without water in case of out of raw water.

3) Liquid Level Controller in Water Tank Controls Inlet pump (Three-phase) (Set b-01)

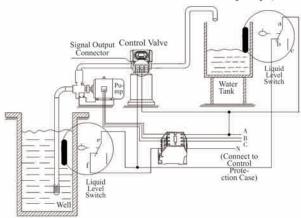


Figure 3-6 Wiring of Liquid Level Switch in Water Tank Controls Inlet Pump

4)Control Inlet Booster Pump(Set b-01 or b-02)

Instruction: If inlet water pressure is less than 0.15MPa, which makes rinse drawing difficult, a booster pump is suggested to be installed on inlet. Control mode b-01. When system in regeneration cycle, booster pump is open, the wiring refers to Figure 3-7. If the booster pump current is bigger than 5A, the system needs to install a contactor, the wiring refers to Figure 3-8.




Figure 3-7Wiring of Booster Pump on Inlet




Figure 3-8 Wiring of Booster Pump on Inlet

B. Interlock

Instruction:

In the parallel water treatment system, it ensures only one valve in regeneration or washing status and (n-1) valves in service, that is, realizing the function of supplying water simultaneously and regenerating individually, the wiring refers to Figure 3-9.

In the series water treatment system(Second grade Na* Exchanger or RO pre-treatment system), it ensures only one valve in regeneration or washing status and there is/are water (s) in service.




Figure 3-9 Network System Wiring with Interlock Cable

Note:

Use interlock cable to connect the black socket of one valve with the blue socket of another valve in series.

One system with several valves, if interlock cable is disconnected, the system is divided into two individual system.

C. Pressure Relief Output

In adopt inlet booster pump or well water supply systems, valve switching will increase the system water feeding pressure, the motor can't rotate. Installing the solenoid valve in the inlet pipeline, connecting with the drain. When the valve switching, the pressure relief solenoid valve opens, the water flows to the drain. Avoiding the system closed, which will cause the inlet pressure rising too fast to damage the valve. The wiring refers to Figure 3-10.

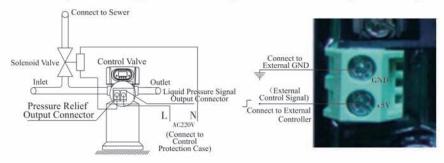


Figure 3-10 Wiring of Pressure Relief Output Figure 3-11 Wiring of Remote Input

D. Remote Handling Connector

When the valve is used to make pure water or other system that can be monitored online or connected to a PC, etc., when the conductivity or other parameters reach the set value or the PC sends a signal and needs system regeneration, it can be provide a signal to remote handling connector of main control board by the signal line, which can make the valve regenerate immediately. The connector receiving the signal is equivalent to pressing the manual button. The wiring refers to Figure 3-11:

E. Interlock System

2 or more than 2 valves are interlocked connecting in one system and all valves are in service but regenerate individually. The wiring refers to Figure 3-12:

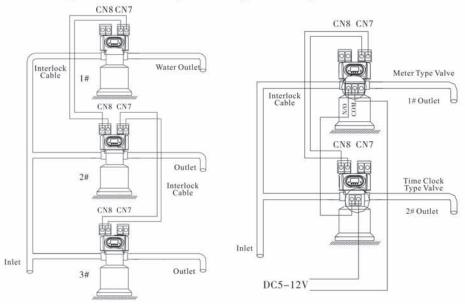


Figure 3-12 Interlock system

Figure 3-13 Series system

F. Series System

This is a 2 or more than 2 valves system, all in service, with one flow meter for the entire system. For the time type valve, the regeneration time should be set and adjusted to the Max; for the meter type valve, connect its signal output connector with the remote handling connector of the time clock type valve. That can realize the function of supplying water simultaneously and regenerating orderly. The wiring refers to Figure 3-13:

3.3. System Configuration and Flow Rate Curve


A. Product Configuration

Product configuration with tank, resin volume, brine tank and injector

Tank Size (mm)	Resin Flow Volume Rate (L) (t/h)		Brine Tank Size (mm)	The Minimum Salt Consumption for Regeneration (Kg)	Injector Model (Old/New)	
ф 180 × 1130	16	0.5	ϕ 230 × 520	2.40	6302/6801	
ф 205 × 1300	25	0.7	ф 390 × 810	4.00	6303/6802	
ф 255 × 1390	40	1.2	ф 390 × 810	6.00	6305/6804	
ф 300 × 1650	60	1.8	ф 450 × 940	9.00	6306/6806	

Note: The flow rate calculation is based on linear velocity 25m/hr; the minimum salt consumption for regeneration calculation is based on salt consumption 150g / L (Resin).

- B. Flow Rate characteristic
- 1). Pressure-flow rate curve

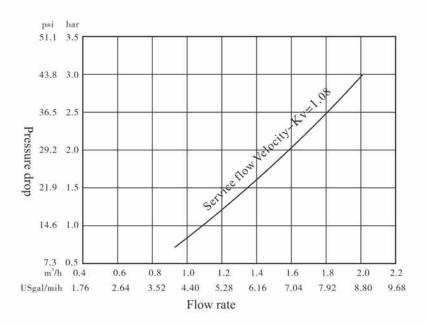

2). Injector Parameter Table Old Injector: (6300 series)

Inlet Pressure	Draw Rate (L/M)										
MPa	6301 Coffee	6302 Pink	6303 Yellow	6304 Blue	6305 White	x - x - x - x - x - x - x - x -	6307 Purple	6308 Red	6309 Green	6310 Orange	
0.15	0.81	1.12	1.58	2.21	2.45	3.30	3.44	4.08	5.19	5.69	
0.20	0.95	1.41	1.87	2.53	2.89	3.88	4.21	4.83	5.36	6.80	
0.25	0.99	1.61	2.08	2.79	3.30	4.30	4.66	5.39	6.86	7.65	
0.30	1.30	1.81	2.18	3.05	3.66	4.74	5.15	5.95	7.50	8.60	
0.35	1.45	1.96	2.39	3.27	3.94	5.02	5.55	6.51	8.30	9.57	
0.40	1.56	2.12	2.55	3.50	4.25	5.41	5.88	6.77	8.74	9.90	

New Injector:(6800 series)

Inlet Pressure		Draw Rate (L/M)										
MPa	6820 Gray	6821 Cyan	6801 Coffee	6802 Pink	6803 Yellow	6804 Blue	6805 White	6806 Black	6807 Purple	6808 Red	6809 Green	6810 Orange
0.15	0.61	0.88	1.30	1.45	2.00	2.68	2.72	3.72	4.52	4.85	5.75	6.00
0.20	0.70	1.03	1.52	1.73	2.37	3.16	3.27	4.27	5.03	5.70	6.40	6.26
0.25	0.79	1.14	1.77	1.90	2.70	3.46	3.78	4.80	5.65	6.22	7.19	7.13
0.30	0.87	1.27	1.93	2.26	3.00	3.80	4.30	5.23	6.20	6.80	7.97	8.53
0.35	0.95	1.35	2.08	2.20	3.23	4.05	4.50	5.57	6.67	7.27	8.50	8.80
0.40	1.00	1.43	2.23	2.27	3.46	4.38	4.88	5.95	6.95	7.63	8.80	9.30

3) Configuration for Standard Injector and Drain Line Flow Control Old Injector:(6300 series)

Tank Dia.	-	Injector	Draw Rate	Slow Rinse Rate	Brine Refill Rate	DLFC	Backwash Fast Rinse Rate
mm	Model	Color	L/m	L/m	L/m		L/m
150	6301	Coffee	1.30	0.91	3.00	1#	4.70
175	6302	Pink	1.81	1.32	3.70	1#	4.70
200	6303	Yellow	2.18	1.73	3.80	2#	8.00
225	6304	Blue	3.05	2.14	3.30	2#	8.00
250	6305	White	3.66	2.81	4.30	3#	14.40
300	6306	Black	4.74	3.32	4.20	3#	14.40

New Injector: (6800 series)

Tank Dia mm	Injector Model	Injector Color	I Rate I Rinse I		BLFC Code	Brine Refill Rate	DLFC Code	Backwash / Fast Rinse Rate	
7. (1.45273)			L/m	L/m	1 1	L/m	1	L/m	
150	6821	Cyan	1.27	0.75	8468057	0.98	8468064	3.33	
175	6801	Coffee	1.93	1.18	8468057	0.98	8468043	4.31	
200	6802	Pink	2.26	1.24	8468056	1.21	8468042	7.15	
225	6803	Yellow	3.00	1.70	8468056	1.21	8468060	7.64	
250	6804	Blue	3.80	2.40	8468052	1.66	8468061	10.82	
300	6806	Black	5.23	3.30	8468053	2.73	8468077	18.10	

4). BLFC Parameter Table (Only for New Injector)

Part Number		8468076	8468075	8468057	8468056	8468052	8468053	8468054	8468055
C	olor	Red	Purple	Black	White	Coffee	Pink	Yellow	Blue
Flow	L/m	0.38	0.68	0.98	1.21	1.66	2.73	4.92	5.86
Rate	gal/min	0.10	0.18	0.26	0.32	0.44	0.72	1.30	1.55

5). DLFC Parameter Table (Only for New Injector)


Pa Nun	ırt nber	8468064	8468043	8468042	8468060	8468061	8468045	8468077	8468044	8468062	8468063	No DLFC
Co	lor	Green	Pink	Coffee	White	Black	Blue	Orange	Yellow	Purple	Red	1
Flow	L/m	3.33	4.31	7.15	7.64	10.82	15.96	18.10	18.50	24.97	30.64	32.00
Rate	-	0.88	1.14	1.89	2.02	2.86	4.22	4.78	4.89	6.60	8.10	8.45

Note: Above data for the product configuration and relevant characteristics are only for reference. When put into practice, it is subject to different requirements of raw water hardness and application.

3.4. Parameter Settlement

1 Service Time T1

Water treatment capacity:

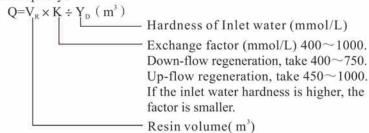

By hours: $T1=Q \div Q_h$ (Hour)

Average water consumption per hour (m³/h)

Water treatment capacity (m³)

By days: $T1=Q \div Q_d$ (Day)

Average water consumption per day (m³/d)

Water treatment capacity (m³)

② Backwash Time T2

Generally, it is suggested to set 10~15 minutes. The higher the turbidity is, the longer backwash time can be set. However, if the turbidity is more than 5FTU, it should be better to install a filter in front of the exchanger.

3 Brine& Slow Rinse Time T3

$$T3=(40 \sim 50) \times H_R \text{ (min)}$$

Generally, $T3=45H_R \text{ (min)}$

In this formula, H_B——The height of resin in exchange tank (m)

4 Brine Refill Time T4

Down-flow regeneration: $T4 = 0.45 \times V_R \div Brine refill speed (min)$

Up-flow regeneration: $T4 = 0.34 \times V_R \div Brine refill speed (min)$

In this formula, V_R——Resin volume (m³)

The Brine refill speed is related to inlet water pressure. It is suggested to be 1~2 minutes longer than the calculated brine refilling time to make sure there is enough water in tank. (The brine tank should be equipped with liquid level controller).

(5) Fast Rinse Time T5

$$T5=12 \times H_p$$
 (min)

Generally, the water for fast rinse is $3 \sim 6$ times of resin volume. It is suggested to be set $10 \sim 16$ minutes. But it should meet the requirements of qualified outlet water.

⑥ Exchange Factor

Exchange factor= $E/(k \times 1000)$

In this formula, E—Resin working exchange capability (mol/m^3) , it is related to the quality of resin. Down-flow regeneration, take $800 \sim 900$. Up-flow regeneration, take $900 \sim 1200$.

K——Security factor, always take $1.2 \sim 2$. It is related to the hardness of inlet water: the higher the hardness is, the bigger the K is.

7 Set Up Interval Backwash Times (Only for F69)

When the turbidity of raw water is higher, the interval backwash time could be set F-00. That is to say, backwash in each regeneration; when the turbidity is lower, the interval backwash

time could be set F-01(Or other number value), it is to say that backwash in every two regeneration. Thus, Service→ Brine& Slow rinse →Brine refill→ Fast rinse →Service→ Backwash →Brine& Slow rinse →Brine refill →Fast rinse.

® Regeneration Time:


The whole cycle for regeneration is about two hours. According to the actual situation, please try to set up the regeneration time when you don't need to use water.

The calculation of parameters for each step is only for reference, the actual proper time will be determined after adjusting by water exchanger supplier. This calculation procedure of softener is only for industrial application; it is not suitable for small softener in residential application.

3.5. Parameter Enquiry and Setting

3.5.1. Parameter Enquiry

When ξ lights on, press and hold both and for 5 seconds to unlock the button; then press and highest on, enter to program display mode; press or to view each value according to below process. (Press exit and turn back to service status)

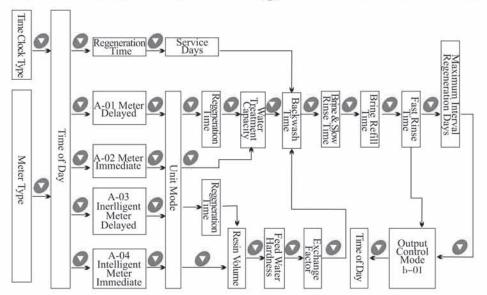

Note: For the F69 valve, after enquiry "Unit Mode" or "Regeneration Time", it will show "F-00", which indicates the interval backwash times.

3.5. 2. Parameter Setting

In program display mode, press and enter into program set mode. Press or to adjust the value.

3.5.3. The steps of parameter setting (Take F69A3, A-01 as sample)

Items	Process steps	Symbol Symbol
Time of Day	When time of day "12:12" continuously flash, it reminds to reset; 1. Press to enter into program display mode; both and "" symbol light on, ": " flashes; Press to set "time of day" mode, both and hour value flash, through or to adjust the hour value; 2. Press again, both and minute value flash, through or to adjust the minute value; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	Ø 8:3 Ø © &
Control Mode	1. In program display mode, press and enter into program set mode, and 01 value flash; 2. Press or , set the value to be A-01/02/03/04 control mode; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	R - D 1
Unit Mode	1. In unit mode display status, press and enter into program set mode, and 01 value flash; 2. Press or and choose the unit from the m³/L/gal; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	ж Ш - Ш I - ®
Regeneration Time	1.In regeneration time display status, press and enter into program set mode. Shows "02:00", and 02 flash; Press or to adjust the hour value; 2. Press again, and 00 flash, press or to adjust the minute value; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	0.200
Interval Backwash Times	1. In interval backwash time display status, it shows F-00. Press and enter into program set mode. And 00 value flash; 2. Press or to adjust the interval backwash times value; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	F - 00

Water Treatment Capacity	1. In water treatment capacity display status, it shows and 10.00. Press and and enter into program set mode. and 10.00 flash; 2. Press or to adjust the water treatment capacity value (m³); 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	1 0.0 0 2
Backwash Time	1. In backwash time display status, it shows and 2-10:00. Press and and enter into program set mode. and 10:00 flash; 2. Press or to adjust the backwash time; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	2-10:00
Brine& Slow Rinse Time	1. In brine & slow rinse time display status, it shows and 3-60:00. Press and enter into program set mode. and 60:00 flash; 2. Press or to adjust the brine time(minute); 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	3-8 0:0 0
Brine Refill Time	1. In brine refill time display status, it shows and 4-05:00, Press and enter into program set mode. and 05:00 flash; 2. Press or to adjust the brine refill time (minute); 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	Y-0 5:0 0
Fast Rinse Time	1. In fast rinse time display status, it shows in and 5-10:00. Press and and enter into program set mode. and 10:00 flash; 2. Press or to adjust the fast rinse time (minute); 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	5-10:00

Maximum Interval Regeneration Days	1. In maximum interval regeneration days display status, it shows H-30. Press and and enter into program set mode. and 30 flash; 2. Press or to adjust the interval regeneration days (day); 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	X - 3 ∏° ⊗
Signal Output Mode	1. In signal output mode display status, it shows b-01. Press and enter into program set mode. and 01flash; 2. Press or to adjust the output mode; 3. Press and hear a sound "Di", then finish adjustment, press to turn back.	b - 0 1 &

For example, the fast rinse time of a softener is 12 minutes. After regenerating, the chloridion in the outlet water is always higher than normal, indicating that there is not enough time for fast rinse. If you want the time to set to 15 minutes, the modification steps as follows:

- ①Press and hold both 🖉 and 🕡 to unlock the button. (🕹 lights off);
- 2Press , and lights on;
- ③Press ♠or ♠ocontinuously until iii lights on. Then the digital area shows: 5-12M;
- 4Press , and 12 flash;
- ⑤Press continuously until 12 changed to 15;
- ⑥Press , there is a sound "Di" and the figure stop flashing; the program back to program display mode.
- (7) If you want to adjust other parameters, you can repeat the steps from (2) to (5); If you don't, press (a) and exit from the program display mode, the display will show the current service status.

3.6. Trial Running

After installing the multi-functional flow control valve on the resin tank with the connected pipes, as well as setting up the relevant parameters, please conduct the trial running as follows:

- A. Close inlet/outlet valve B and valve C, open bypass valve A, clean the impurity in the pipe, and then close the by-pass valve A. (As Figure 1-3 shows)
- B. Add calculated water to the brine tank and adjust the air check valve. Then add solid salt to the brine tank and dissolve the salt as much as possible.
- C. Switch on power. Press and enter into the backwash status; when lights on, slowly open the inlet valve B to 1/4 position, making the water flows into the resin tank; you can hear the sound of air-out from the drain pipeline. After all air is out of pipeline, then open inlet valve B completely and clean the impurity in the resin tank until the outlet water is clean. It will take 8~10 minutes to finish the whole process.
- D. Press , and turn the status from backwash to brine slow rinse; when lights on and enter in the process of brine slow rinse. The air check valve close when control valve finished sucking brine, then slow rinse starts to work. It is about 60~65minutes for whole process.
- E. Press to brine refill status. When lights on and it indicates the brine tank is being refilled with water to the required level. It takes about 5~6minutes, then add solid salt to the brine tank.
- F. Press , and turn to fast rinse status. When it lights on and starts to fast rinse. After 10~15 minutes, take some outlet water for testing: if the water hardness reaches the requirement, and the content of chloridion in the outlet water is almost same as the inlet water, then the valve can go to the next step.
- G. Press , make the control valve return to service status; I lights on and starts running.

Note:

- When the control valve enters into the regeneration status, all program can be finished automatically according to the setting time; if you want one of steps to be terminated early, you can press .
- If water inflows too fast, the media in tank will be damaged. When water inflows slowly, there is a sound of air emptying from drain pipeline.
- After changing resin, please empty air in the resin according to above step C.
- In the process of trial running, please check the water situation in all positions, ensuring there is no resin leakage.
- The time for Backwash, Brine & Slow Rinse, Brine Refill and Fast Rinse status can be set and executed according to the calculation in the formula or suggested from the control valve suppliers.

3.7. Trouble-Shooting

A. Control Valve Fault

Problem	Cause	Correction
1. Softener fails to regenerate.	A. Electrical service has been interrupted. B. Regeneration time set incorrect. C. Controller damaged. D. Motor fails to work.	A. Assure permanent electrical service (Check fuse, plug, switch and so on). B. Reset regeneration time. C. Replace controller. D. Replace motor.
2. Regeneration time is not correct.	A. Time of day does not set correctly. B. Power failure for more than 3 days.	A.Check program and reset time of day. B.Reset time of day.
3. Softener supply hard water.	A. Bypass valve is open or leaking. B. No salt in brine tank. C. Injector plugged. D. Insufficient water flows into brine tank. E. O-ring on riser pipe leaks. F. Internal valve leaks. G.Regeneration cycles are not correct or raw water quality deterioration. H. Shortage of resin. I. Bad quality of feed water or impeller blocked.	A. Close or repair bypass valve. B. Make sure there is solid salt in the brine tank. C. Change or clean injector. D. Check brine tank refill time. E. Make sure riser pipe is not cracked. Check o-ring and tube pilot. F. Check and repair valve body. G. Set correct regeneration time or water capacity. H. Add resin to mineral tank and check whether resin leaks. I. Reduce the inlet turbidity, clean or replace flow meter.
4. Softener fails to draw brine.	A. Inlet pressure is too low. B. Brine line plugged. C. Brine line leaks. D.Injector plugged or damaged. E. Internal control leaks. F. Drain line plugged. G. Sizes of injector and DLFC are not matched with tank.	A. Increase inlet pressure. B. Clean brine line. C. Clean brine line. D. Clean or replace injector. E. Repair or replace valve body. F. Check drain line. G. Select correct injector size and DLFC according to the instruction requirements.
5. Unit used too much salt.	A. Improper salt setting. B. Excessive water in brine tank.	A. Check salt usage and salt setting. B. See problem no.6.
6. Excessive water in brine tank.	A. Overlong brine refill time. B. Excess water left after brine. C. Foreign material in brine valve. D. Not install liquid level controller and power failure in brine status. E. Brine refill is uncontrolled.	A. Reset correct brine refill time. B. Check the injector and make sure no stuff in the brine pipe. C. Clean liquid level controller and brine line. D. Stop water supplying and restart or installs liquid level controller in salt tank when power restored. E. Repair or replace liquid level controller.

7. Pressure lost or the pipe rusty.	A. Iron scale in the water supply pipe. B. Iron scale accumulated in the softener. C. Fouled resin bed. D. Too much iron in the raw water.	A. Clean the water supply pipe. B. Clean valve and add resin cleaning chemical, increase frequency of regeneration. C. Check backwash, brine draw and brine tank refill. Increase frequency of regeneration and backwash time. D. Iron removal equipment is required to install before softening.
8. Resin discharged through drain pipe	A. Air in water system. B. Strainer is broken. C. Large drain flow rate when backwash.	A. Empty the air from the system. B. Replace new strainer. C. Check and adjust proper drain rate.
9. Control valve cycle continuously.	A. Locating signal wire breakdown. B. Controller is faulty. C. Foreign material stuck the driving gear. D. Time of regeneration steps were set to zero.	A. Check and connect locating signal wire. B. Replace controller. C. Take out foreign material. D. Check program setting and reset.
10. Drain flows continuously.	A. Internal valve leaks. B. Power off when in backwash or fast rinse.	A. Check and repair valve body or replace it. B. Adjust valve to service status or turn off bypass valve and restart when electricity supply.
11. Interrupted or irregular brine.	A. Water pressure is too low or not stable. B. Injector is plugged or damaged. C. Air in resin tank. D. Floccules in resin tank during up-flow regeneration.	A. Increase water pressure. B. Clean or replace injector, C. Check and find the reason. D. Clean the floccules in resin tank.
12. Water flows out from drain or brine pipe after regeneration.	A. Foreign material in valve which makes valve can't be closed completely. B. Hard water mixed in valve body. C. Water pressure is too high, which results in valve not getting the right status D. In the backwash status, the outlet line and brine line are connected.	A. Clean foreign material in valve body. B. Change valve core or sealing ring. C. Reduce water pressure or use pressure release function. D. Install a check valve, solenoid valve in front of the outlet or install a liquid level controller in the brine tank.
13. Salt water in outflow pipe	A. Foreign material in injector or injector fails to work. B. Brine valve cannot be shut-off. C. Fast rinse time is too short.	A. Clean and repair injector. B. Repair brine valve and clean it. C. Extend fast rinse time.


14. Water capacity decreases.	A. Regenerate not properly. B. Fouled resin bed. C. Salt setting is not proper. D. Softener setting is not proper. E. Raw water quality deteriorated. F. Impeller has already gotten stuck.	A. Regenerate according to the right way. B. Increase backwash flow rate and times, clean or change resin. C.Reset the appropriate amount of salt D. According to the test of outlet water, recount and reset. E. Regenerate by manual temporary then reset regeneration cycle. F. Disassemble flow meter and clean it, or replace a new flow meter.
-------------------------------	---	--

B. Controller Fault


Problem	Cause	Correction
All indictors display on display board.	A. Wiring of display board with control board fails to work. B. Control board damaged. C. Transformer damaged. D. Electrical service is not stable.	A. Check and replace the wiring. B. Replace control board. C. Check and replace transformer. D. Check and adjust electrical service.
2. No display on display board.	A. Wiring of display board with controller fails to work. B. Display board damaged. C. Control board damaged. D. Electricity is interrupted.	A. Check and replace wiring. B. Replace display board. C. Replace control board. D. Check electricity.
3. E1 Flashes	A. Wiring of locating board with control board fails to work. B. Locating board damaged. C. Mechanical driven failure. D. Control board damaged. E. Wiring of motor with control board is fault. F. Motor damaged.	A. Replace wiring. B. Replace locating board. C. Check and repair mechanical part. D. Replace control board. E. Replace wiring. F. Replace motor.
4. E2 Flashes	A. Hall component on locating board damaged. B. Wiring of locating board with control board fails to work. C. Control board damaged.	A. Replace locating board. B. Replace wiring. C. Replace control board.
5. E3 or E4 Flashes	A. Control board damaged	A. Replace control board.

3.8. Assembly & Parts

Flow Meter Connector & Animated Connector

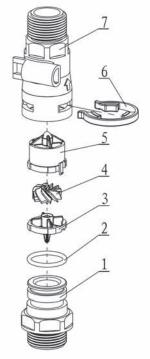



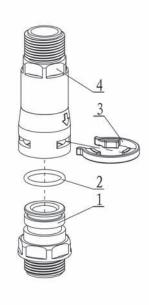


5457003 Animated Connector

	5447020 Flow	Meter		
Item No.	Description	Part No.	Quantity	
1	Animated Nut	8458014	1	
2	O-ring	8378064	1	
3	Impeller Supporter	5115023	1	
4	Impeller	5436013	1	
5	Impeller Supporter	5115024	1	
6	Clip	8270005	1	
7	Shell	8002006	1	

3	5457003 Animate	ed Connecto	or
Item No.	Description	Part No.	Quantity
1	Animated Nut	8458014	1
2	O-ring	8378064	1
3	Clip	8270005	1
4	Connector	8458039	1

F65B3&F69A3 Valve Body Assembly

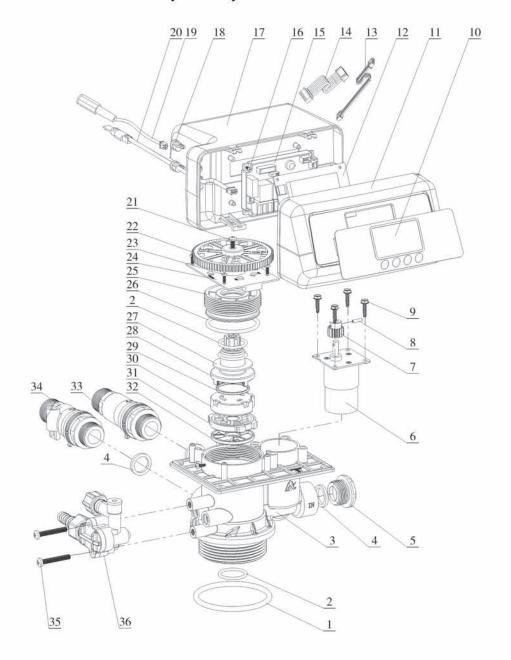


F65B3/F65B1 Valve Body Components (Item No.20,34,35 only for 65B3)

Item No.	Description	Part No.	Quan- tity	Item No.	Description	Part No.	Quan- tity
1	O-ring 73 × 5.3	8378143	1	19	Wire for Power	5513001	1
2	O-ring 25.8 × 2.65	8378078	3	20	Probe Wire	6386014	1
3	Valve Body (ABS+GF10)	5022018	- 1	21	Screw, Cross ST3.9 × 13	8909013	1
**	Valve Body (PPO+GF20)	5022019		22	Big Gear, Driven	5241005	1
4	Seal Ring	8371019	3	23	Screw, Cross ST2.9 × 9.5	8909008	7
5	Plug	8323005	1	24	Locating Board	6380003	1
6	Motor	6158006	1	25	Fitting Nut	8092007	1
7	Small Gear, Motor	8241010	1	26	O-ring 50.39 × 3.53	8378107	1
8	Pin	8993003	1	27	Anti-friction Washer	8216010	1
9	Screw, Cross ST3.9 × 16	8909044	4	28	Shaft	8258009	1
10	Label	8865004	1	29	Moving Seal Ring	8370053	1
11	Front Cover	8300004	1	30	Moving Disk	8459013	1
12	Display Board	6381003	1	31	Fixed Disk	8469012	1
13	Wire for Display Board	5512001	1	32	Seal Ring	8370025	1
14	Wire for Locating Board	5511001	1	33	Animated Connector	5457003	1
15	Control Board	6382003	1	34	Flow Meter	5447020	1
16	Screw, Cross ST2.2 × 6.5	8909004	2	35	Screw, Cross M5 × 35	8902017	2
17	Dust Cover	8005005	1		Old Injector(6300)	5468005	
18	Cable Clip	8126004	2	36	New Injector(6800)	5468111	1

F69A3/F69A1 Valve Body Components (Item No. 20, 34, 35 only for F69A3)

Item No.	Description	Part No.	Quan- tity	Item No.	Description	Part No.	Quan- tity
1	O-ring 73 × 5.3	8378143	1	19	Wire for Power	5513001	1
2	O-ring 25.8 × 2.65	8378078	3	20	Probe Wire	6386014	1
3	Valve Body (ABS+GF10)	5022024	1	21	Screw, Cross ST3.9 × 13	8909013	1
٥	Valve Body (PPO+GF20)	5022025	1	22	Big Gear, Driven	5241005	1
4	Seal Ring	8371019	3	23	Screw, Cross ST2.9 × 9.5	8909008	7
5	Plug	8323005	1	24	Locating Board	6380008	1
6	Motor	6158006	1	25	Fitting Nut	8092007	1
7	Small Gear, Motor	8241010	1	26	O-ring 50.39 × 3.53	8378107	1
8	Pin	8993003	1	27	Anti-friction Washer	8216010	1
9	Screw, Cross ST3.9 × 16	8909044	4	28	Shaft	8258009	1
10	Label	8865008	1	29	Moving Seal Ring	8370053	1
11	Front Cover	8300008	1	30	Moving Disk	8459016	1
12	Display Board	6381003	1	31	Fixed Disk	8469015	1
13	Wire for Display Board	5512001	1	32	Seal Ring	8370034	1
14	Wire for Locating Board	5511001	1	33	Animated Connector	5457003	1
15	Control Board	6382003	1	34	Flow Meter	5447020	1
16	Screw, Cross ST2.2 × 6.5	8909004	2	35	Screw, Cross M5 × 35	8902017	2
17	Dust Cover	8005008	1		Old Injector(6300)	5468005	
18	Cable Clip	8126004	2	36	New Injector(6800)	5468111	1

F65G3 & F69G3 Valve Body Assembly

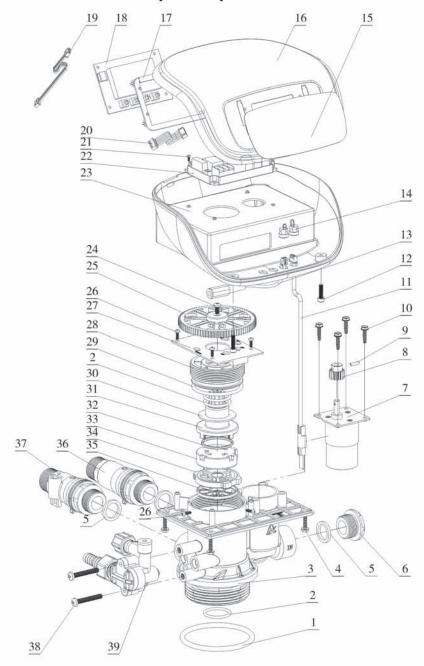


F65G3/F65G1 Valve Body Components (Item No. 10, 35, 36 only for F65G3)

Item No.	Description	Part No.	Quan- tity	Item No.	Description	Part No.	Quan- tity
1	O-ring 73 × 5.3	8378143	1	21	Control Board	6382003	1
2	O-ring 25.8 × 2.65	8378078	3	22	Screw, Cross ST2.2×6.5	8909004	2
2	Valve Body (ABS+GF10)	5022018		23	Dust Cover	8005020	1
3	Valve Body (PPO+GF20)	5022019	1	24	Screw, Cross ST3.9×13	8909013	1
4	Screw, Cross ST3.9 × 16	8909016	4	25	Big Gear, Driven	5241005	1
5	Seal Ring Φ24 × Φ18 × 3	8371019	3	26	Screw, Cross	8909008	7
6	Plug	8323005	1	27	ST2.9×9.5 Locating Board	6380003	1
7	Motor	6158006	1	28	Fitting Nut	8092007	1
8	Small Gear, Motor	8241010	1	29	O-ring 50.39×3.53	8378107	1
9	Pin	8993003	1	30	Anti-friction Washer	8216010	1
10	Screw, Cross ST3.9 × 16	8909044	4	31	Shaft	8258009	1
11	Probe Wire	6386014	1	32	Moving Seal Ring	8370053	1
12	Socket Head Cap Screws	8902016	2	33	Moving Disk	8459013	1
13	Wire for Power	5513001	1	34	Fixed Disk	8469012	1
14	Cable Clip	8126004	2	35	Seal Ring	8370025	1
15	Label	8865021	1	36	Animated Connector	5457003	1
16	Front Cover	5300002	1	37	Flow Meter	5447020	1
17	Toggle	8109028	1	38	Screw, Cross M5×35	8902017	2
18	Display Board	6381003	1		Old Injector(6300)	5468005	
19	Wire for Display Board	5512001	1	39	New Injector(6800)	5468111	1
20	Wire for Locating Board	5511001	1				

F69G3/F69G1 Valve Body Components (Item No. 10, 35, 36 only for F69G3)

Item No.	Description	Part No.	Quan- tity	Item No.	Description	Part No.	Quan- tity
1	O-ring 73 × 5.3	8378143	1	21	Control Board	6382003	1
2	O-ring 25.8 × 2.65	8378078	3	22	Screw, Cross ST2.2×6.5	8909004	2
3	Valve Body (ABS+GF10)	5022024	- 1	23	Dust Cover	8005020	1
3	Valve Body (PPO+GF20)	5022025		24	Screw, Cross ST3.9×13	8909013	1
4	Screw, Cross ST3.9 × 16	8909016	4	25	Big Gear, Driven	5241005	1
5	Seal Ring Φ24 × Φ18 × 3	8371019	3	26	Screw, Cross ST2.9×9.5	8909008	7
6	Plug	8323005	1	27	Locating Board	6380008	1
7	Motor	6158006	1	28	Fitting Nut	8092007	1
8	Small Gear, Motor	8241010	1	29	O-ring 50.39×3.53	8378107	1
9	Pin	8993003	1	30	Anti-friction Washer	8216010	1
10	Screw, Cross ST3.9 × 16	8909044	4	31	Shaft	8258009	1
11	Probe Wire	6386014	1	32	Moving Seal Ring	8370053	1
12	Socket Head Cap Screws	8902016	2	33	Moving Disk	8459016	1
13	Wire for Power	5513001	1	34	Fixed Disk	8469015	1
14	Cable Clip	8126004	2	35	Seal Ring	8370034	1
15	Label	8865021	1.	36	Animated Connector	5457003	1.
16	Front Cover	5300002	1	37	Flow Meter	5447020	1
17	Toggle	8109028	1	38	Screw, Cross M5×35	8902017	2
18	Display Board	6381003	1		Old Injector(6300)	5468005	
19	Wire for Display Board	5512001	1	39	New Injector(6800)	5468111	1
20	Wire for Locating Board	5511001	1		,		Į.


Structure Chart of New Injector:

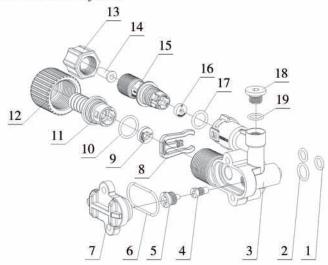

New Injector (6800 seires) Components:

Item No.	Description	Part No.	Quan- tity	Item No.	Description	Part No.	Quan- tity
1	O-ring 7.5×1.8	8378016	2	11	Connector	8458064	1
2	O-ring 10.82×1.78	8378012	1	12	Animated Nut	8945025	1
3	Injector Body	8008010	1	13	Nut Nex. Hd	8940001	1
4	Throat	Optional	1	14	Tube	8457004	1
5	Nozzle	Optional	1	15	Connector	8458068	1
6	O-ring 30×1.8	8378025	1	16	O-ring 11×2	8378169	1
7	Injector Cover	8315001	1	17	BLFC	Optional	1
8	Clip	Optional	1	18	Plug	8323002	1
9	DLFC	8468061	1	19	Seal Ring	8370003	1
10	O-ring 15×1.8	8378179	1				

Structure Chart of Old Injector:

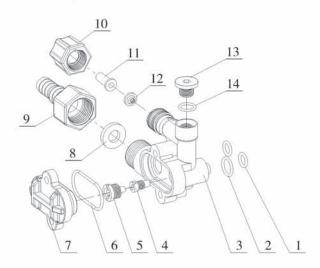

Old Injector (6300 series) Components:

Item No.	Description	Part No.	Quan- tity	Item No.	Description	Part No.	Quan- tity
1	O-ring 7.5×1.8	8378016	2	8	DLFC	8468005	1
2	O-ring 10.82×1.78	8378012	1	9	Connector	8458017	1
3	Injector Body	8008001	1	10	Nut Nex. Hd	8940001	1
4	Throat	8467005	1	11	Tube	8457004	1
5	Nozzle	8454005	1	12	BLFC	8468002	ī
6	O-ring 30×1.8	8378025	1	13	Plug	8323002	1
7	Injector Cover	8315001	1	14	Seal Ring	8370003	1

4. Warranty Card

Dear client:

This warranty card is the guarantee proof of Runxin brand multi-functional flow control valve. It is kept by client self. You could get the after-sales services from the supplier which is appointed by Runxin manufacturer. Please keep it properly. It couldn't be retrieved if lost. It couldn't be repaired free of charge under the below conditions:

- 1. Guarantee period expired.(One year):
- 2. Damage resulting from using, maintenance, and keeping that are not in accordance with the instruction:
- 3. Damage resulting from repairing not by the appointed maintenance personnel;
- 4. Content in guarantee proof is unconfirmed with the label on the real good or be altered;
- 5. Damage resulting from force majeure.

Product Name	Multi-functional Flow Control Valve for Water Treatment Systems					
Model		Code of Valve Body				
Purchase Company Name		Tel/Cel.				
Problem						
Solution						
Date of Repairing	Date Accomplis					

When product need warranty service, please contact with your direct supplier first, after got permission, then fill in the below content and sent this card together with the product to the appointed suppliers or Runxin company.

End-user	11 1			1			
Company Name			Tel/C	Tel/Cel.			
Purchase Company Name				Tel/C	Tel/Cel.		
Model			Code of Valve Body				
Tank Size 	×	Resin Siz		L	Raw Water Hardness	mmol/L	
Water Source: Ground-water Tap Water		Water Treatment Capacity		m³	Backwash Time	min	
Brine & Slow Rinse Time min		Brine Refill Time		min	Fast Rinse Time	min	
Problem Description							



WENZHOU RUNXIN MANUFACTURING MACHINE CO.,LTD

ADD: NO.169, RUNXIN ROAD, SHANFU TOWN, WENZHOU, ZHEJIANG, CHINA. TEL.:0086-577-88630038, 88576512, 85956057 FAX:0086-577-88633258 E-MAIL: sales@run-xin.com http://www.run-xin.com